


NOTES

1. CONCRETE SHALL USE TYPE II ACID RESISTANT CEMENT IN CONFORMANCE WITH ASTM C478 WITH A MINIMUM COMPRESSIVE STRENGTH OF 4000 PSI AT 28 DAYS. ALL REINFORCING BARS SHALL BE ASTM A615 GRADE 60 STEEL
2. PROVIDE DOWELS FOR CONNECTION AT 12" SPACING, PENETRATING AT LEAST 6 INCHES INTO EXISTING MANHOLE AND PROVIDE SEAL ALONG JOINT USING ELASTOMERIC GROUT

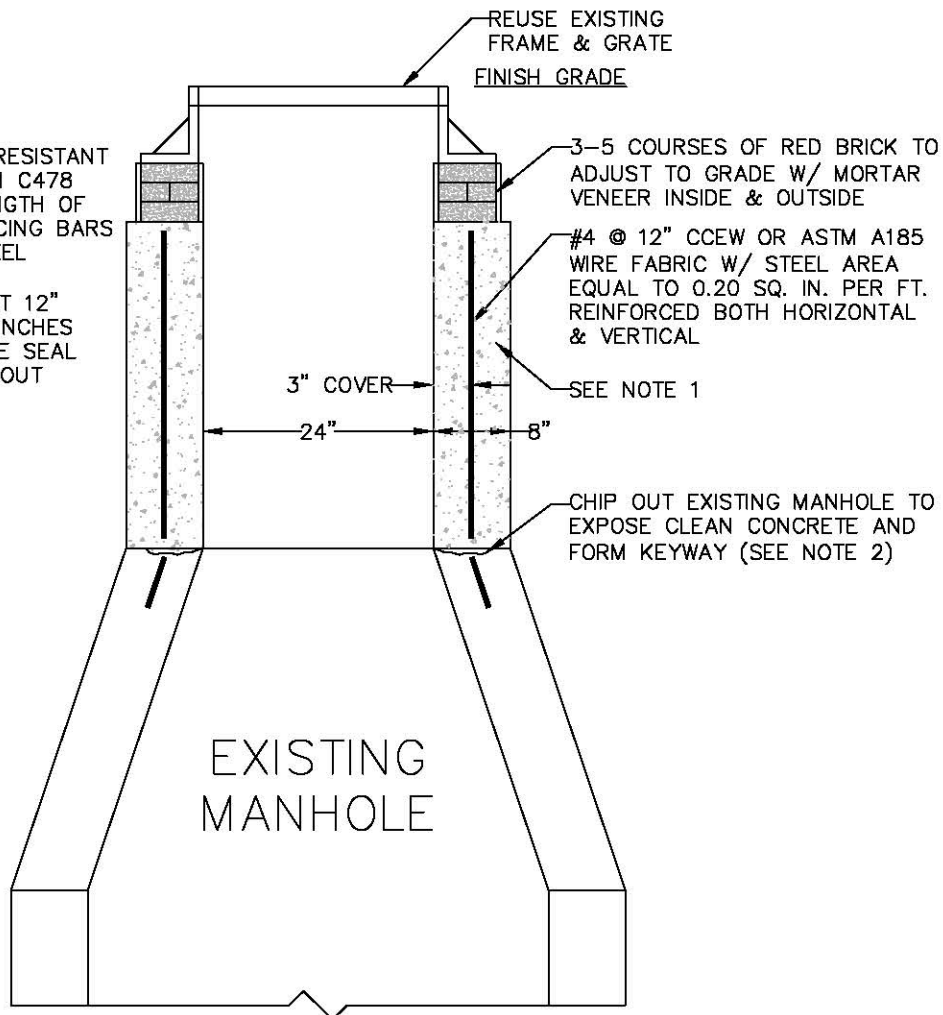

MANHOLE EXTENSION ADJUSTMENT
N.T.S.

F:\WORK\ALL\CAD-DWG\STANDARDS\CMB_STANDARD_DETAILS\Public Works Manual\CMB Sanitary Details